NOTES:

TO BE USED WHEN CLEAR DISTANCE (FROM EXTERIOR PIPE DIAMETER TO EXTERIOR PIPE DIAMETER) BETWEEN SANITARY SEWER PIPING (MAINS, LATERALS, FORCE MAINS, ETC.) AND ALL OTHER PIPES IS 18" OR LESS, PER ENGINEER'S DIRECTION, OR WHERE NOTED ON THE CONSTRUCTION PLANS. A MINIMUM CLEAR DISTANCE OF 3" MUST BE PROVIDED TO MAINTAIN THE STRUCTURAL INTEGRITY OF THE CONCRETE.

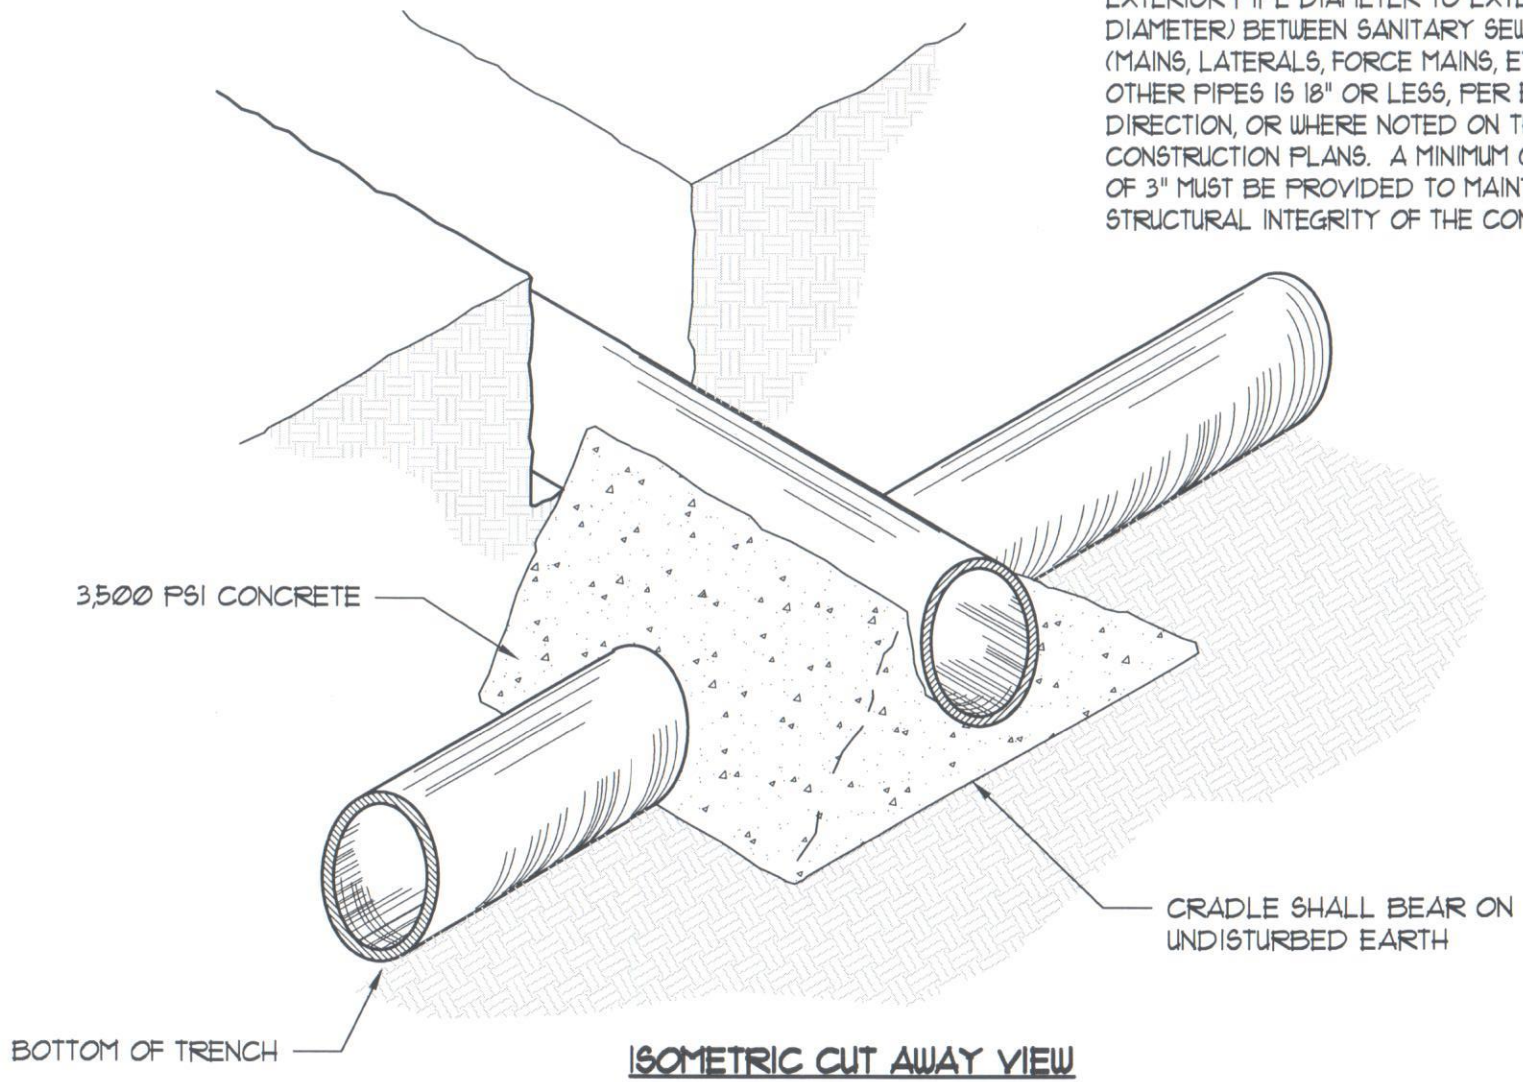

ISOMETRIC CUT AWAY VIEW

City of Carmel Utilities STANDARD DETAILS		TITLE: CONCRETE CRADLE DETAIL
DATE: September 2012 DRAWING: CS31	SCALE: Not To Scale	DRAWN BY: Jones & Henry Engineers, Ltd. FORT WAYNE, INDIANA