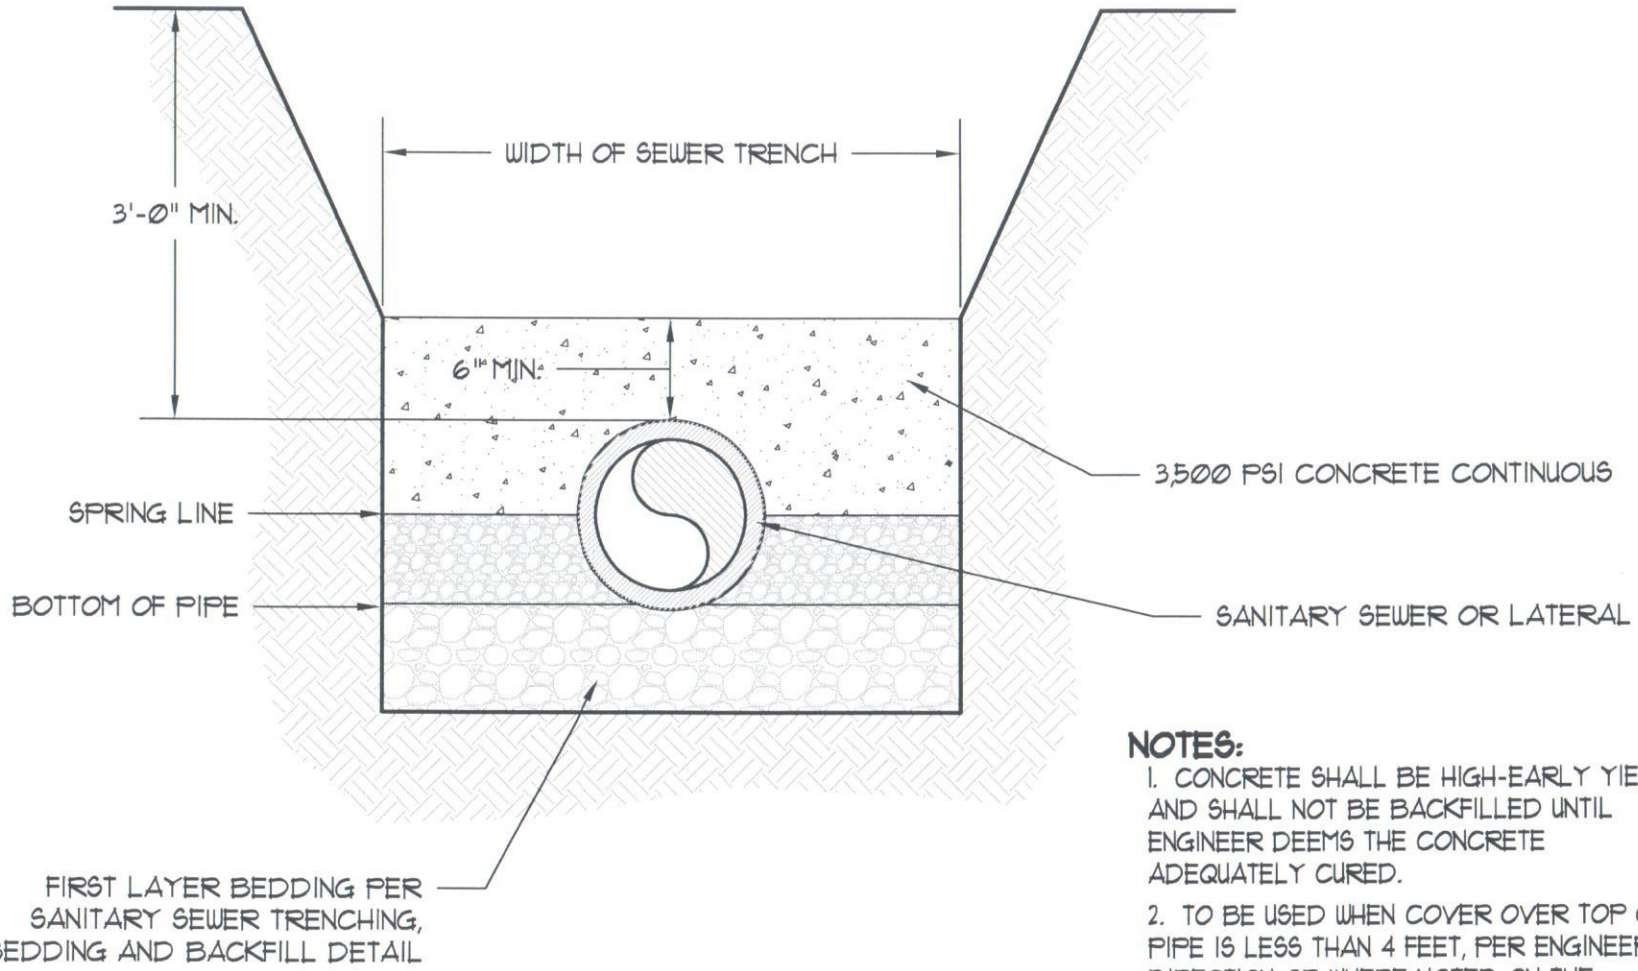

NOTES:

1. CONCRETE SHALL BE HIGH-EARLY YIELD AND SHALL NOT BE BACKFILLED UNTIL ENGINEER DEEMS THE CONCRETE ADEQUATELY CURED.
2. TO BE USED WHEN COVER OVER TOP OF PIPE IS LESS THAN 4 FEET, PER ENGINEER'S DIRECTION OR WHERE NOTED ON THE CONSTRUCTION PLANS.

City of Carmel Utilities STANDARD DETAILS		TITLE: CONCRETE CAP DETAIL
DATE: September 2012 DRAWING: CS33	SCALE: Not To Scale	DRAWN BY: Jones & Henry Engineers, Ltd. FORT WAYNE, INDIANA